

Material Test Report

Client: Miscellaneous

Project: Miscellaneous

Date of Issue:
THIS DOCUMENT SHALL NOT BE REPRODUCED EXCEPT IN FULL


Sample Details

Sample ID: Bricklaying Sand
Field Sample: BS11001
Date Sampled: 29/09/2011
Source: Stockpile
Material: Bricklaying Sand
Specification: Bricklaying
Sampling Method: Hand Sampling [AS1141.3.1]
Location:
GPS Easting:
GPS Northing:

Other Test Results

Description	Method	Result	Limits
Clay and Fine Silt (%)	AS 1141.33	22	15 – 35
Moisture Content (%)	AS 1289.2.1.1	4.0	

Particle Size Distribution

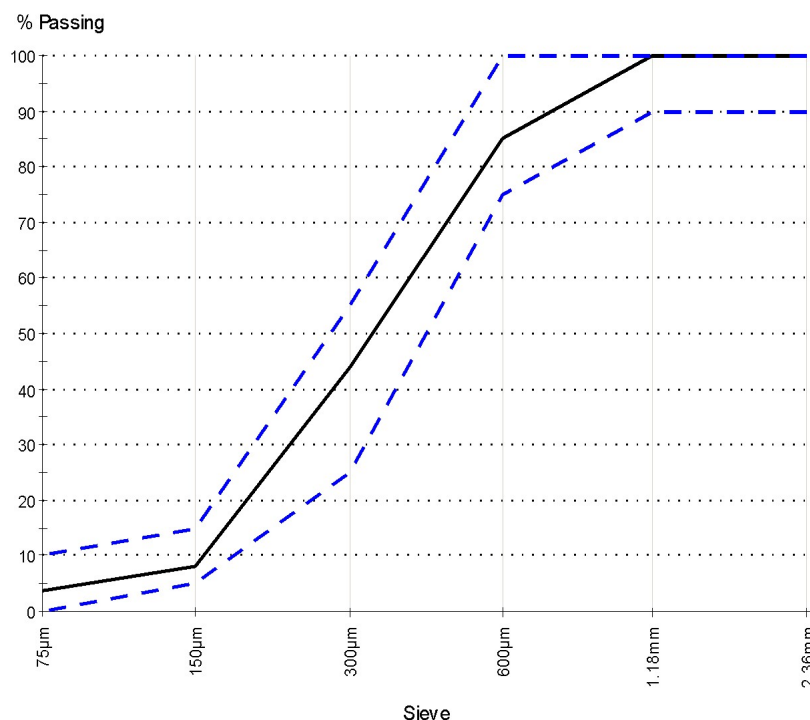

Method: AS 1141.11.1

Drying by: Hotplate

Note: Sample Washed

Sieve Size	% Passing	Limits
2.36mm	100	90 – 100
1.18mm	100	90 – 100
600µm	85	75 – 100
300µm	44	25 – 55
150µm	8	5 – 15
75µm	4	0 – 10

Comments

N/A